



TECHNICAL BULLETIN

Mercury Vapor Lamp

**Mercury Vapor Reflector Lamp
HRFF100PD/R30/E26R**

ANSI Code: H38



Product Code: 71250

Features:

- Built-in Reflector
- Medium Base
- Long Life
- Nickel Plated Base
- Rugged Construction

PERFORMANCE DATA

Initial lumens at rated watts after 100 hours operation	2800	lm
Mean lumens at 10hrs/start	2240	lm
Average life	24000	h
Warm up time (90% lumens)	4	min
Correlated color temperature	4100	K
CIE chromaticity	.375, .367	x,y
Color rendering index	40	
Operating Position	ANY	
Time to hot re-start	10	min

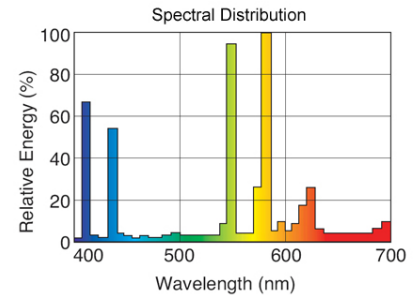

ELECTRICAL CHARACTERISTICS

Nominal lamp wattage	100	W
Nominal lamp voltage	130	V
Nominal lamp current	.85	Arms
Max. starting current	1.85	Arms
Current crest factor	2.0 max	

BALLAST REQUIREMENTS

Open circuit voltage	198	V _{rms}
-30°C (-22°F)	280	V _{peak}

BEAM CHARACTERISTICS

Beam Lumens (0-62°)	1600	lm
Axial Beam Intensity (0°)	620	cd
Beam Spread	125	deg


PHYSICAL DESCRIPTION

Maximum overall length	138 (5.43)	mm (in)
Bulb diameter	95 (3.75)	mm (in)
Base to bulb eccentricity (max)	3	deg
Maximum base temperature	190 (374)	°C (°F)
Maximum bulb temperature	400 (752)	°C (°F)
Bulb material	Borosilicate (Hard Glass)	
Bulb designation	R30	
Bulb finish	Diffused	
Base designation	Medium	


FIXTURE REQUIREMENT

Enclosed Fixture Required

LUMEN MAINTENANCE

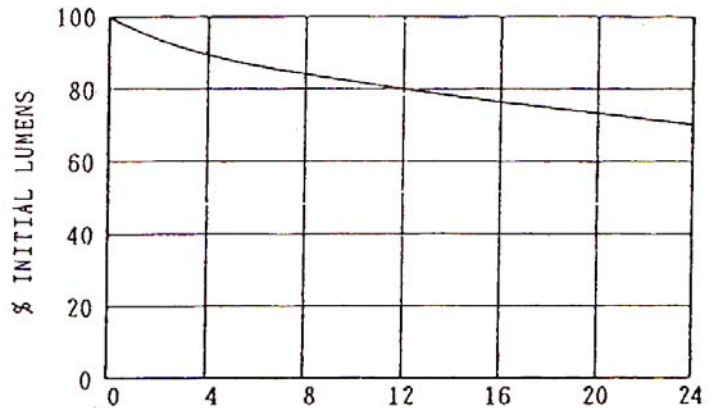

LAMP MORTALITY

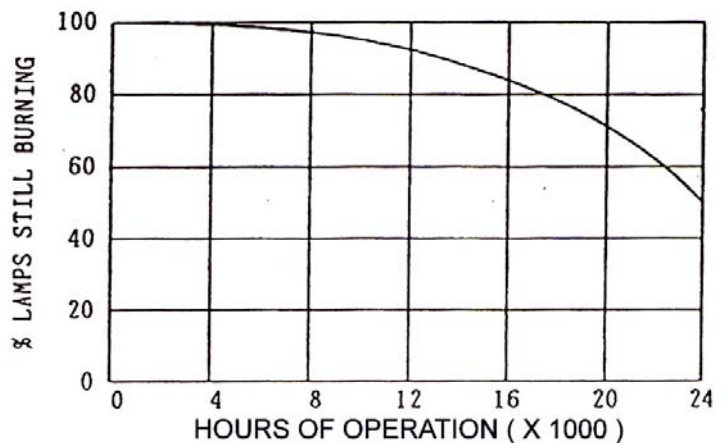

ISO 9001:2008 Certified ISO 14001:2004 Certified

OSHAS 18001:2007 Certified ISO 17025:2005 Accredited



**EYE LIGHTING INTERNATIONAL
OF NORTH AMERICA, INC.**

A SUBSIDIARY OF IWASAKI ELECTRIC CO., LTD.

EQS-N-52-78-71250

Address: 9150 Hendricks Rd., Mentor, OH 44060

Phone: 888-665-2677 Fax: 800-811-7395 E-Mail: sales@eyelighting.com

Phone: (440) 350-7000 Fax: (440) 350-7001 Web: www.eyelighting.com



TECHNICAL BULLETIN

Mercury Vapor Lamp

Mercury Vapor Reflector Lamp
HRFF100PD/R30/E26R

⚠WARNING

This lamp can cause serious skin burn and eye inflammation from short-wave ultraviolet radiation if outer envelope of the lamp is broken or punctured. Do not use where people will remain for more than a few minutes unless adequate shielding or other safety precautions are used. Lamps that will automatically extinguish when the outer envelope is broken or punctured are commercially available.

RISK OF ELECTRIC SHOCK

- Turn power off before inspection, installation or removal
- Protect lamp from direct contact with liquids to avoid breakage from thermal shock

RISK OF FIRE

- Keep combustible materials away from lamp during operation

UNEXPECTED LAMP RUPTURE MAY CAUSE INJURY, FIRE, OR PROPERTY DAMAGE

- Do not exceed rated ballast voltage
- Do not use lamp if outer glass is scratched or broken.
- Do not use beyond rated life
- Do not turn on lamp until fully installed
- Use only with a fixture and ballast rated for this product
- Turn lamp off at least once a week for 15 minutes
- Electrically insulate any metal to glass support in fixture

⚠CAUTION

RISK OF BURN

- Allow lamp to cool before handling.

LAMP MAY SHATTER AND CAUSE INJURY

- Do not use excessive force when installing lamp
- Dispose of lamp in a closed container

LAMP OPERATING INSTRUCTIONS

This is a discharge lamp and requires some time to restart and come up to full brightness after a power interruption. If power supply dips or is interrupted, lamps may extinguish and not restart. Turn off power supply for 10-15 minutes and allow lamp to fully cool. Lamp will restart when power is restored.

R

Conforms to:
USA: 21CFR1040.30 Canada: ANSI 136.1-2000

(Hg) - LAMP CONTAINS MERCURY. Manage in Accord with Disposal Laws. See: www.lamprecycle.org or 1-888-665-2677.



ISO 9001:2008 Certified ISO 14001:2004 Certified

OSHAS 18001:2007 Certified ISO 17025:2005 Accredited



**EYE LIGHTING INTERNATIONAL
OF NORTH AMERICA, INC.**

A SUBSIDIARY OF IWASAKI ELECTRIC CO., LTD.

EQS-N-52-78-71250

Address: 9150 Hendricks Rd., Mentor, OH 44060
Phone: 888-665-2677 Fax: 800-811-7395 E-Mail: sales@eyelighting.com
Phone: (440) 350-7000 Fax: (440) 350-7001 Web: www.eyelighting.com

October 22, 2010